


# Smoke / Carbon Monoxide Monitor with Power Supply

UM3A-2212-EU-PSU



Link to BS5839-6 Domestic Smoke & Heat Alarms  
Silent Alert Explained

Published July, 2021

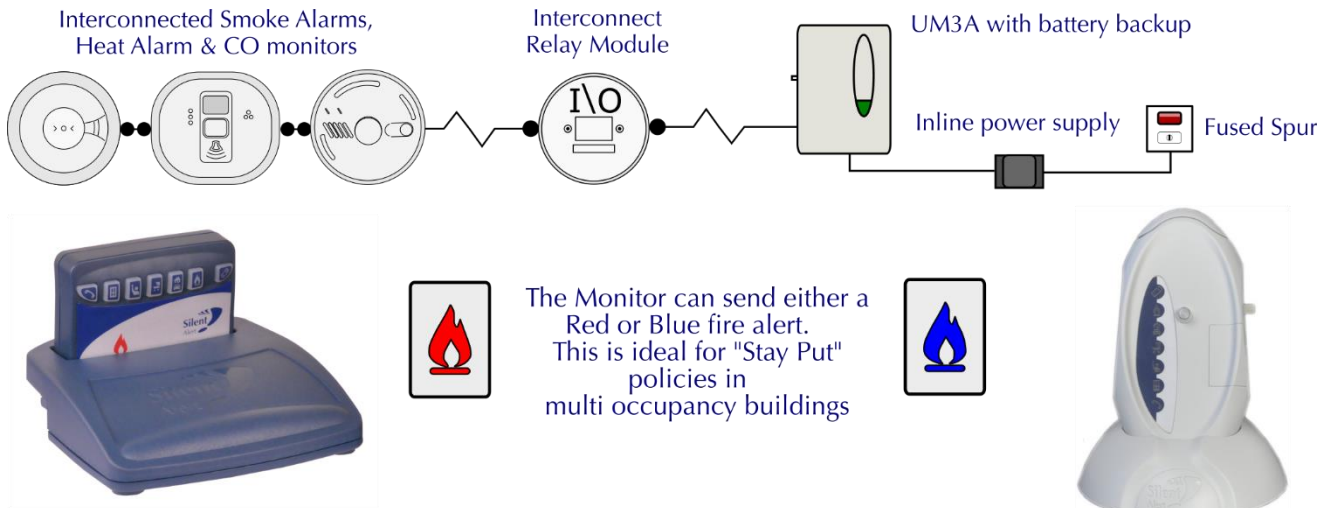

## Linking into existing BS5839-6 domestic Smoke & Heat Alarm Systems

The Silent Alert Smoke / Carbon Monoxide Monitor is designed to link to LD1, LD2 & LD3 compliant domestic smoke & heat alarm systems, automatically alerting deaf & hard of hearing people of an alarm to a vibrating pager and / or SignWave flashing sounder.

Linked via a relay module to interlinked systems any existing compliant system can be made accessible to deaf and hard of hearing people without the need to double up or replace existing detectors.

## Handy Tip – Stay Put Policy

Fully compatible with the Fire Safe System it is possible for a user in a multi occupancy building to be alerted to the activation of both the main fire alarm as well as alarms within their own flat. The Fire Safe system will always light the fire key red and it is possible to set the Smoke / Carbon Monoxide to light the fire key blue so as the user can differentiate between a fire alarm (red) and smoke alarm (blue) activation and take the appropriate action.

## Handy Tip – AICO Relay Units

AICO produce three types of relay unit for their popular interconnected alarms. The Ei128R Hard Wired Relay Module, the Ei128RBU Hard Wired Relay Module with battery backup and the Ei428 RadioLink Relay Module with battery backup. These all switch a relay when any of the interconnected alarms activate which in turn triggers our system. Please contact us if you need to link into non AICO systems and we will assist in helping you select the correct Relay Module.